

### **WHAT**

The project involves upgrading about 3.5 miles of electric transmission line to 69-kilovolt standards.

### WHY

The improvements:

- · Increase electric reliability in the area
- · Reduce the likelihood of outages in the area


### **WHERE**

- · City of Muncie
- · Center Township in Delaware County

Plans call for rebuilding some sections of power line in the company's existing right-of-way. Other sections may include re-routes and require new easements.



# PROJECT SCHEDULE

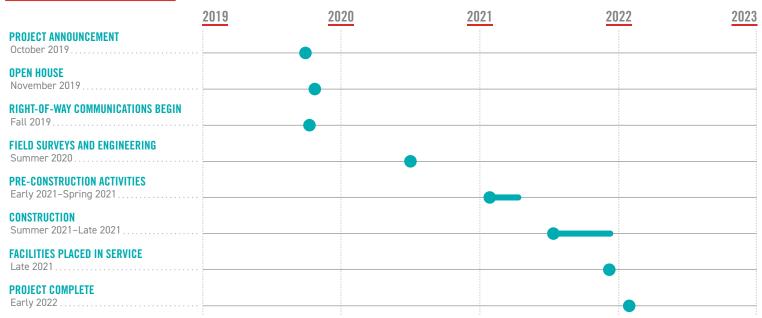

## **TYPICAL STRUCTURES**


The project involves installing steel poles.

Structure Height: 60-90 feet\*

Right-of-Way Width: Approximately 50 feet\*

\*Exact structure, height and right-of-way requirements may vary



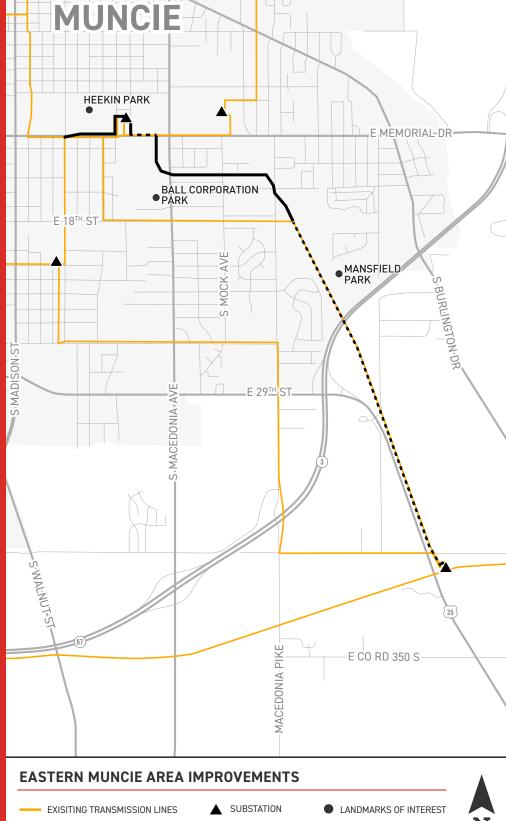

PROPOSED LINE ROUTE

#### **I&M VALUES YOUR INPUT ABOUT THIS PROJECT. PLEASE SEND COMMENTS AND QUESTIONS TO:**



Indiana Michigan Power c/o Brian Recker P.O. Box 60 Fort Wayne, IN 46801



brecker@aep.com

--- LINE TO BE REBUILT



(380) 205-5381



IndianaMichiganPower.com/EasternMuncie

