

LOTT

138 KV TRANSMISSION LINE PROJECT



AEP Ohio officials plan to strengthen the electric transmission system in Delaware County. The project involves building approximately 4 miles of 138-kilovolt (kV) transmission line and one substation to help improve electric reliability for customers.



WHAT

- Building about 4 miles of power line
- Building one substation

*This project requires Ohio Power Siting Board (OPSB) approval

WHY


The improvements increase electric reliability in the area.

WHERE

The project area includes Porter and Trenton townships in Delaware County.



PROJECT SCHEDULE

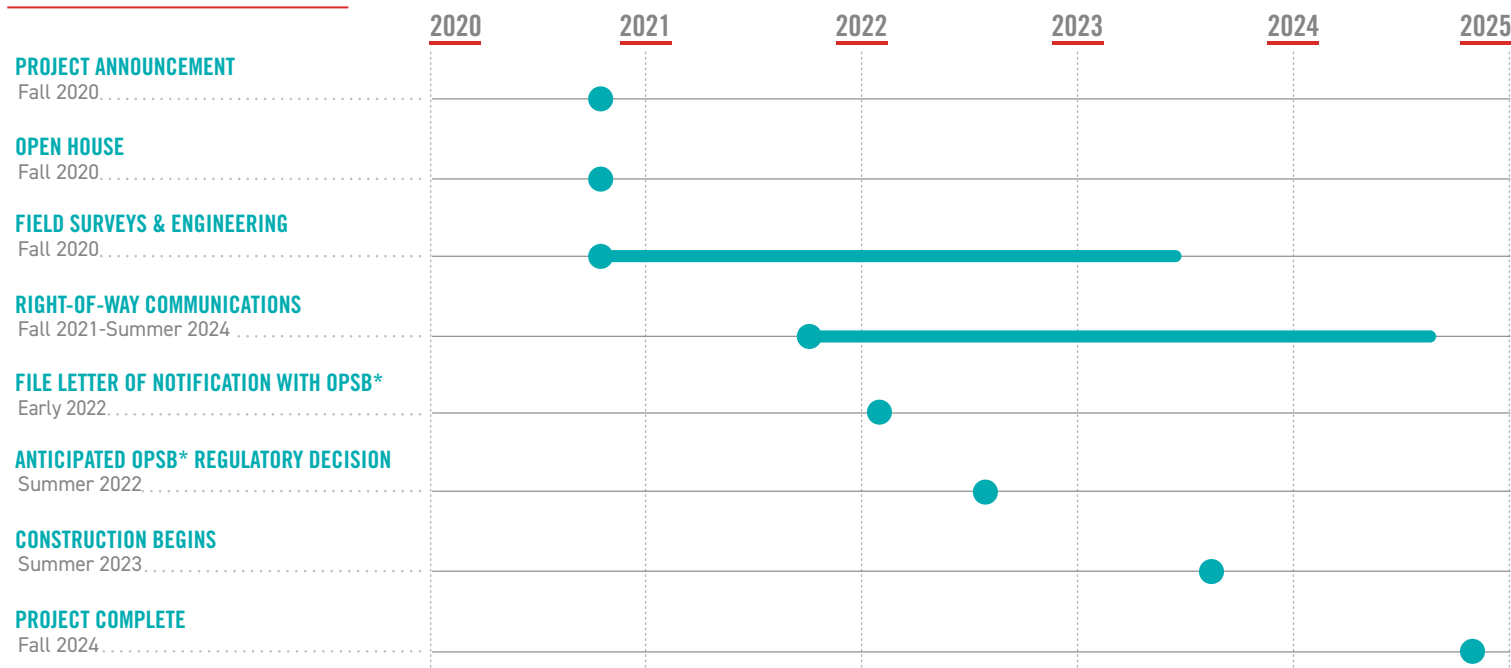


**Timeline subject to change.
*OPSB: Ohio Power Siting Board

LOTT 138 KV TRANSMISSION LINE PROJECT



- EXISTING TRANSMISSION LINE
- STUDY SEGMENTS
- EXISTING SUBSTATION
- PROPOSED SUBSTATION

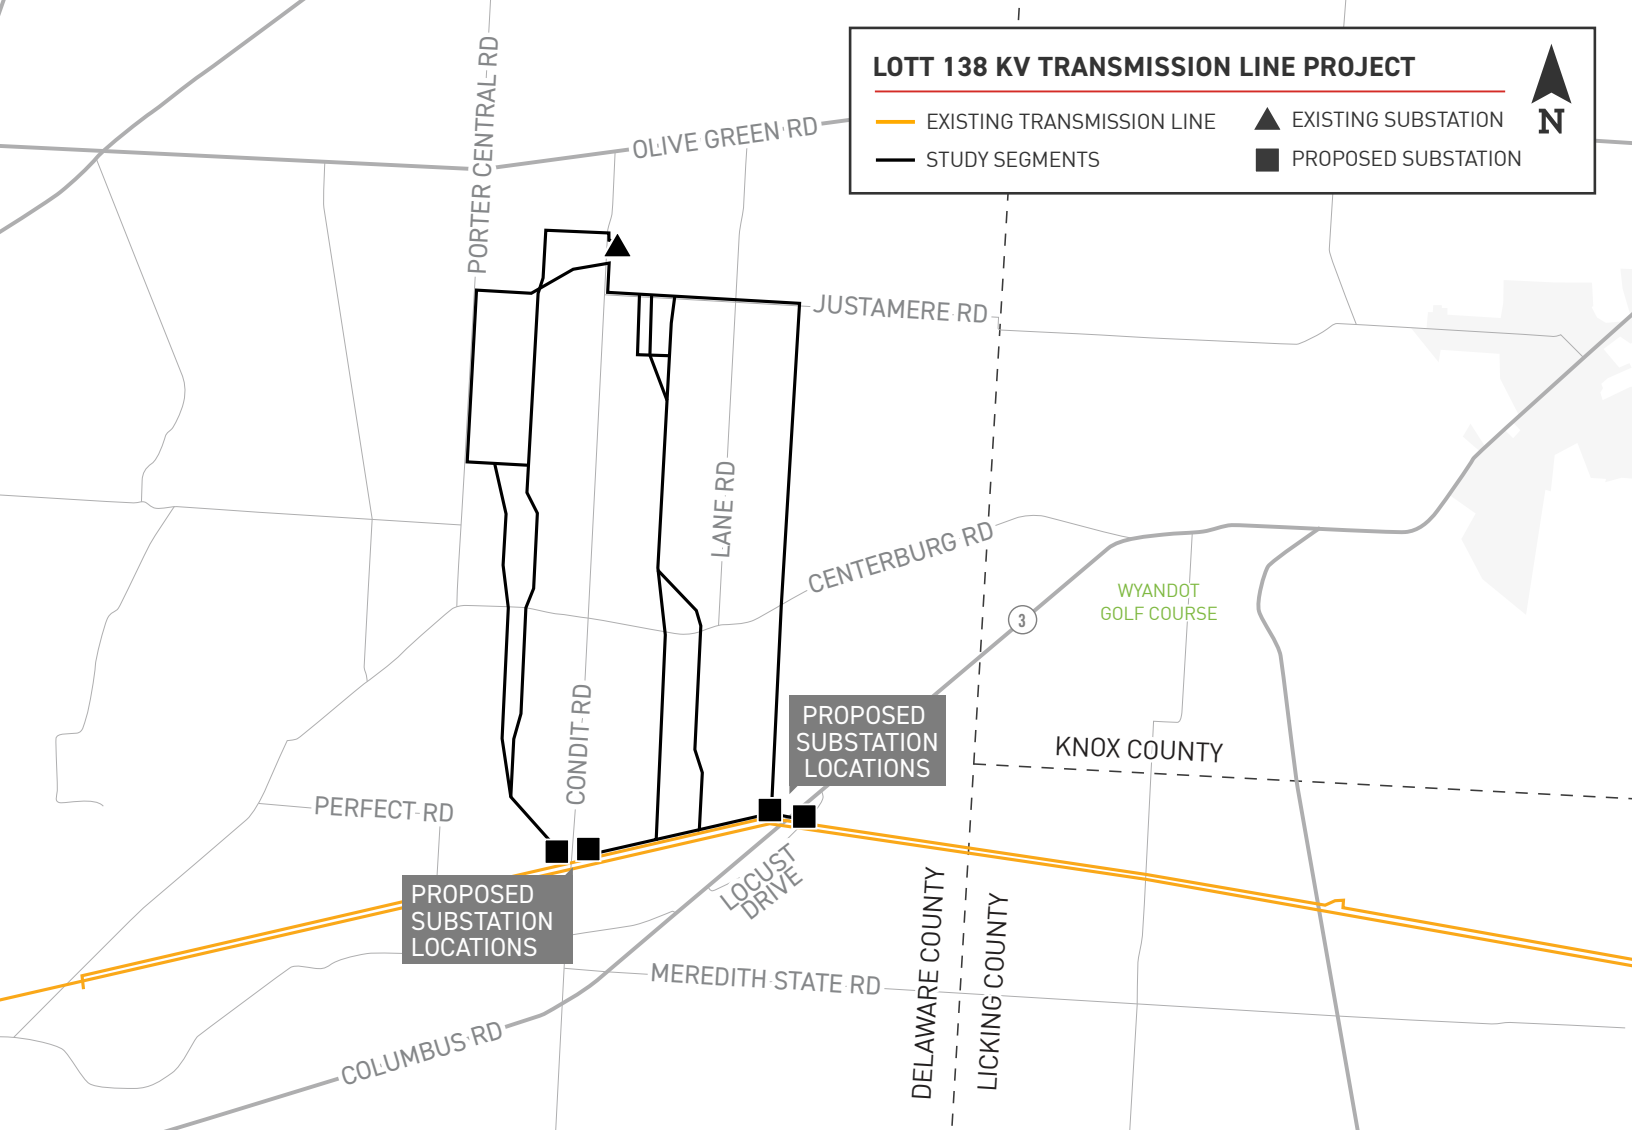


TYPICAL STRUCTURES

The project involves the use of single, steel poles.


Structure Height: **Approximately 80-100 feet***




Right-of-Way Width: **Approximately 100 feet***

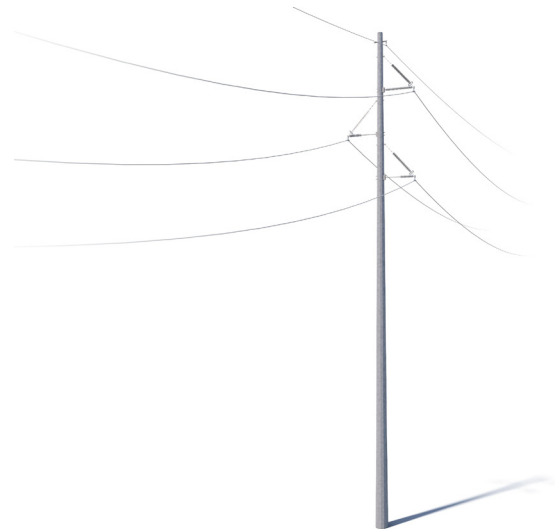*Exact structure, height and right-of-way requirements may vary



AEP OHIO VALUES YOUR INPUT ABOUT THIS PROJECT. PLEASE SEND COMMENTS AND QUESTIONS TO:

 AEP Ohio
c/o Maggie Beggs
8600 Smiths Mill Rd
New Albany OH 43054

 mrbeggs@aep.com
 (380) 205-5178
 AEPOhio.com/Lott

