

NEW LEXINGTON-SHAWNEE

69-KV TRANSMISSION LINE REBUILD PROJECT



An AEP Company

BOUNDLESS ENERGY™

AEP Ohio representatives plan power grid upgrades in eastern Ohio. The proposed improvements in Perry County involve rebuilding about 9 miles of power line and upgrading two substations. These improvements increase reliability, reduce power outages and speed recovery of service when outages occur.

WHAT

- Rebuilding about 9 miles of 69-kilovolt of power line
- Replacing existing wood poles with steel poles
- Upgrading two substations

WHY


The improvements increase electric service reliability in the area.

WHERE

The project area includes Salt Lick and Pike townships in Perry County.



PROJECT SCHEDULE

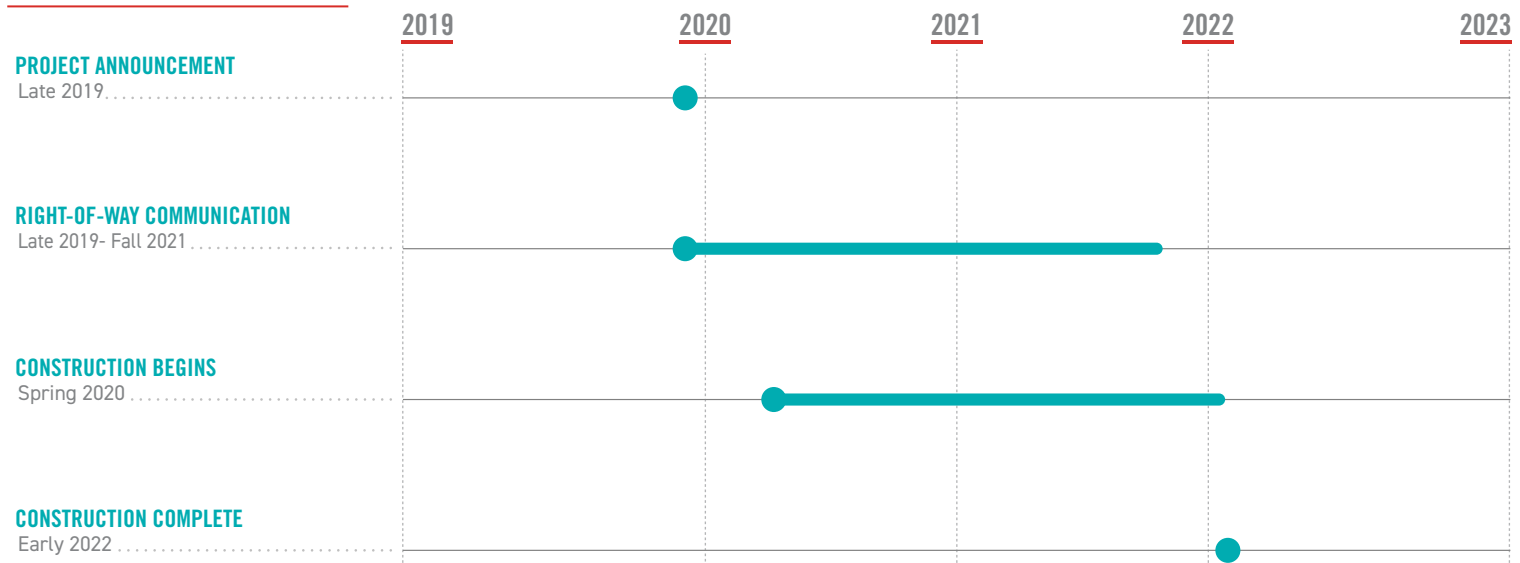

*Timeline subject to change.


TYPICAL STRUCTURES

The proposed project involves using steel poles.

Structure Height: **Approximately 90 feet***

Right-of-Way Width: **Approximately 50 feet***

*Exact structure, height and right-of-way requirements may vary

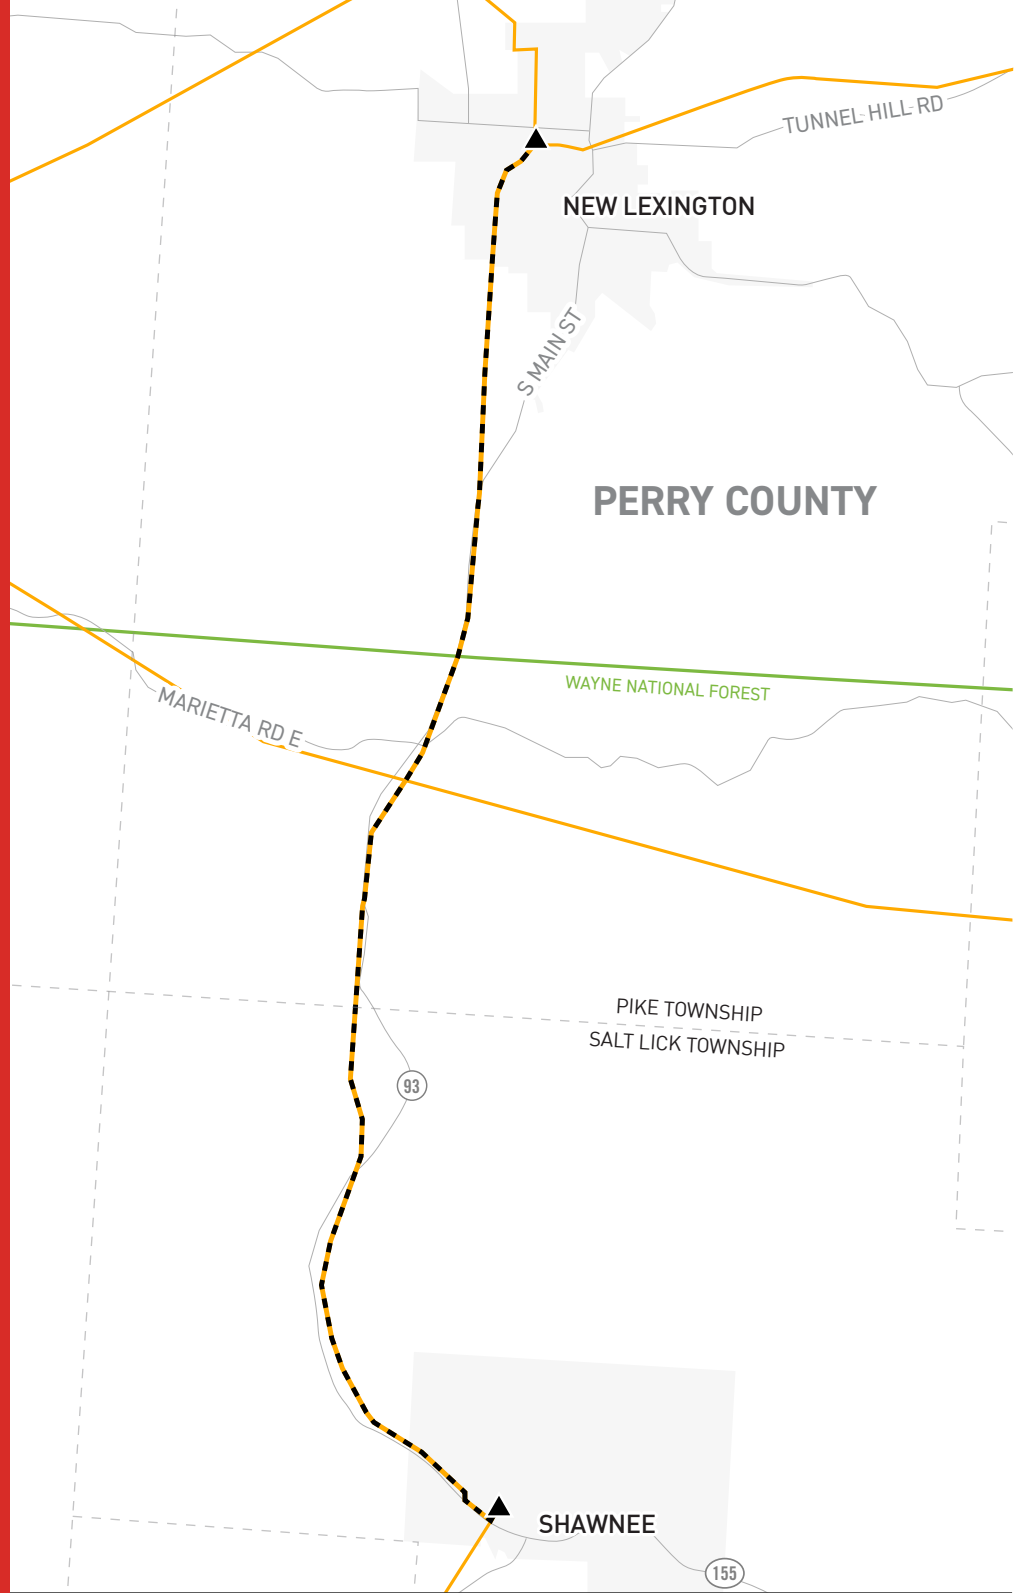

NEW LEXINGTON-SHAWNEE 69-KV TRANSMISSION LINE REBUILD PROJECT

--- TRANSMISSION LINE TO BE REBUILT
— EXISTING TRANSMISSION LINE

▲ EXISTING SUBSTATIONS



AEP OHIO VALUES YOUR INPUT ABOUT THIS PROJECT. PLEASE SEND COMMENTS AND QUESTIONS TO:

✉ AEP Ohio
c/o Joseph Demaree
8600 Smiths Mill Rd
New Albany OH 43054

✉ jkdemaree@aep.com
☎ (380) 205-5046
➡ AEPOhio.com

